


DETAIL A


TRANSVERSE CONSTRUCTION OR SAWED CONTRACTION JOINTS

FOR DETAILS OF SHOULDER SEE PLANS

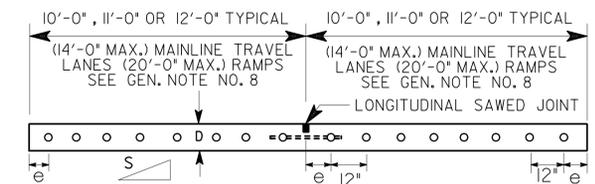

SEE PLANS FOR REQUIRED SLOPE
UNIFORM THICKNESS DOWELED PORTLAND CEMENT CONCRETE PAVING WITH CENTER JOINT AND TIE BARS AND 90° TRANSVERSE CONTRACTION JOINTS AT 15 FT. INTERVALS
e = 6" UNLESS SPECIFIED OTHERWISE

SECTION A-A
SECTION THROUGH TRANSVERSE JOINT

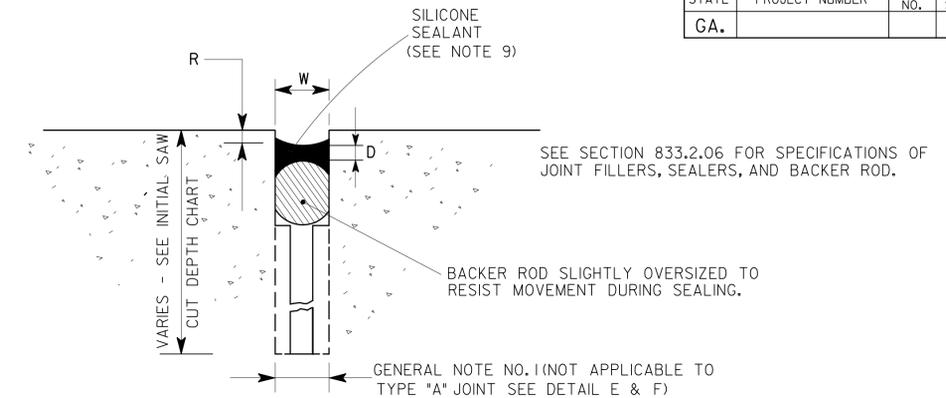


DETAIL B
CONTRACTION OR CONSTRUCTION JOINT

REQUIRED MINIMUM DEPTH OF INITIAL SAW CUT FOR LONGITUDINAL AND TRANSVERSE JOINTS. ALL INITIAL CUTS TO BE 1/8" IN WIDTH.


JOINT SCHEDULE			
TYPE	W	D	R
TRANSVERSE JOINT	1/4"	1/4"-3/8"	3/8" TO 1/2"
LONGITUDINAL SAWED JOINT	1/4"	1/4"-3/8"	3/8" TO 1/2"
JOINT FOR ADJOINING LANE FOR TYPE "A" JOINT	1/4"	1/4"-3/8"	3/8" TO 1/2"

DEPTH OF PAVEMENT D	DEPTH OF CUT
6"	1 3/4"
6 1/2"	1 7/8"
7"	2"
7 1/2"	2 1/8"
8"	2 1/4"
8 1/2"	2 3/8"
9"	2 1/2"
9 1/2"	2 5/8"
10"	2 3/4"
10 1/2"	2 7/8"
11"	3"
11 1/2"	3 1/8"
12"	3 1/4"

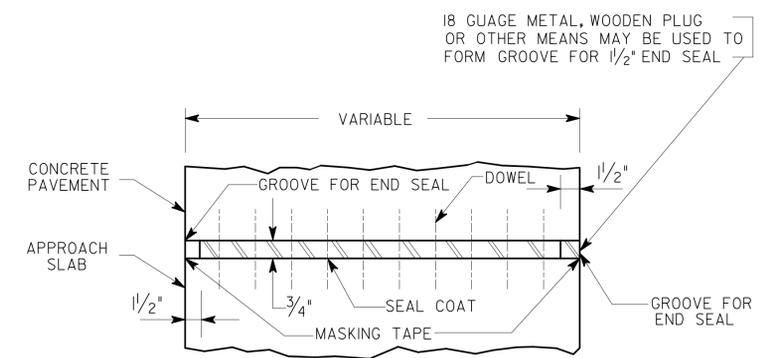

DETAIL C

PLAN OF TRANSVERSE EXPANSION JOINT BETWEEN PAVEMENT AND BRIDGE APPROACH SLAB

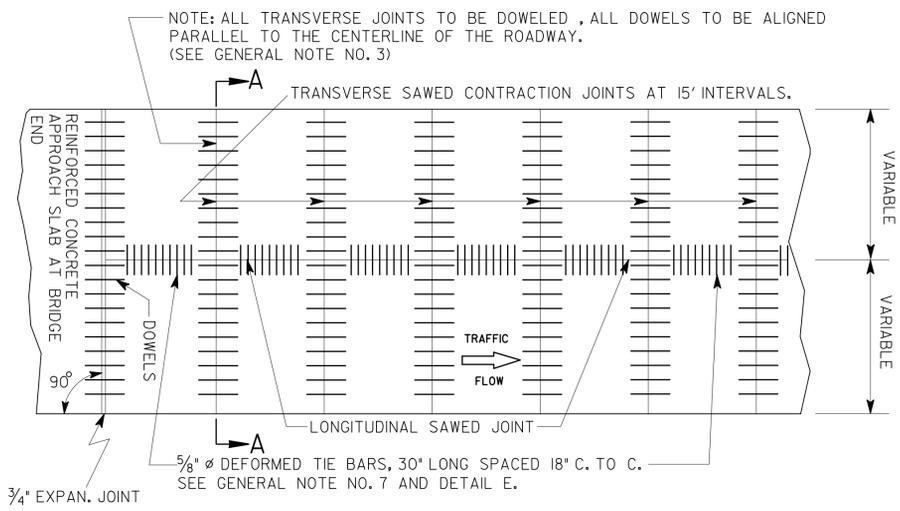


STANDARD JOINT LAYOUT


WHERE A NEW LANE WILL BE ADJOINING AN EXISTING P.C. CONCRETE PAVED LANE, THE SPACING FOR THE TRANSVERSE JOINTS IN THE NEW LANE WILL BE VARIED FROM THAT SHOWN ABOVE WHERE NECESSARY TO MATCH THE TRANSVERSE JOINTS IN THE EXISTING LANE. WHEN EXISTING PAVING JOINTS EXCEED 25 FEET IN LENGTH AN INTERMEDIATE TRANSVERSE JOINT WILL BE ESTABLISHED IN THE NEW LANE AT MID-SLAB.

REQUIRED DOWEL BAR DIAMETERS


PAVEMENT THICKNESS (D)	DOWEL BAR DIAMETERS
6"	1 1/4"
6 1/2"	1 1/4"
7"	1 1/4"
7 1/2"	1 1/4"
8"	1 1/4"
8 1/2"	1 1/4"
9"	1 1/4"
9 1/2"	1 1/2"
10"	1 1/2"
10 1/2"	1 1/2"
11"	1 1/2"
11 1/2"	1 1/2"
12"	1 1/2"

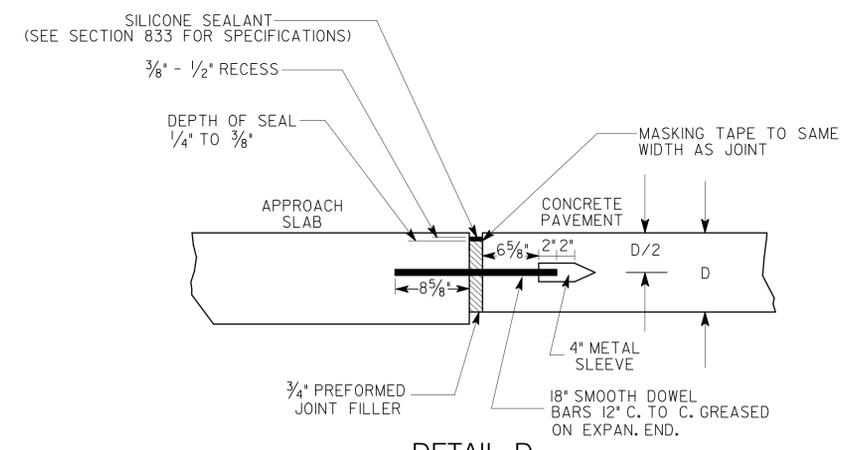

DETAIL D
EXPANSION JOINT

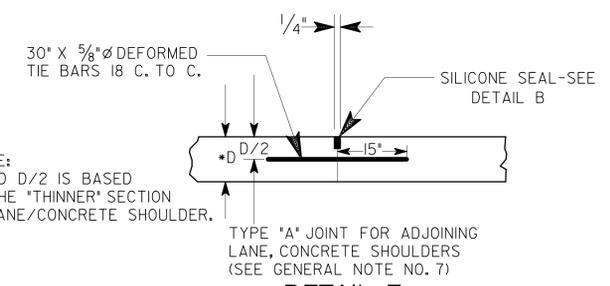

DETAIL E
ADJOINING LANES, CONCRETE SHOULDER, LONGITUDINAL SAWED OR FORMED JOINTS

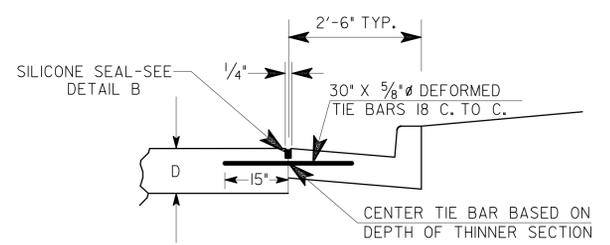

DETAIL F
ADJOINING CURB AND GUTTER

GENERAL NOTES:

- THE LOCATION OF THE INITIAL SAW CUT MAY VARY BETWEEN THESE LINES.
- CONTRACTION JOINT FOR CONCRETE SHOULDERS SHALL CONFORM WITH TRANSVERSE SAWED CONTRACTION JOINT IN MAINLINE PAVEMENT.
- TRANSVERSE JOINTS SHALL BE PERPENDICULAR TO THE CENTER LINE OF THE LANE BEING PLACED, EXCEPT WHERE NEW LANES ARE PLACED AGAINST EXISTING LANES WITH SKEWED JOINTS. THE NEW JOINTS WILL MATCH THE SKEW OF THE EXISTING PAVEMENT.
- JOINTS IN ACCELERATION AND DECELERATION LANES ARE TO COINCIDE WITH MAINLINE JOINTS, BUT MAY BE NORMAL TO ACCELERATION OR DECELERATION EDGE.
- GA. STD. SPECIFICATIONS (SEC. 430) FOR TOLERANCE ON DOWELS.
- CASES WHERE CONCRETE CURB AND GUTTER IS PLACED ADJACENT TO A CONCRETE ROADWAY SLAB, THE LONGITUDINAL JOINT SHALL BE SAWED AND SEALED OR FORMED AND SEALED AS A LONGITUDINAL JOINT AS SHOWN BY THE STANDARD.
- NO TIE BAR SHALL BE LOCATED CLOSER THAN 18" TO A TRANSVERSE JOINT. WHERE NEW CONCRETE WILL BE ADJOINING EXISTING CONCRETE, DO NOT TIE NEW CONCRETE TO EXISTING CONCRETE.
- SPACING BETWEEN LONGITUDINAL JOINTS SHALL NOT EXCEED 14'-0" FOR MAINLINE TRAVEL LANES. RAMP PAVEMENT SECTIONS OVER 14'-0" WIDE SHALL HAVE A LONGITUDINAL SAWED JOINT ALONG THE CENTERLINE AND THE SPACING BETWEEN LONGITUDINAL JOINTS SHALL NOT EXCEED 20'-0".
- WHEN SELF LEVELING SILICONE SEALANT IS USED, TOOLING OF THE SEALANT TO OBTAIN A CONCAVE SURFACE IS NOT REQUIRED IF SEALANT MEETS DIMENSIONS OF DETAIL B.

1-18-18		DEPARTMENT OF TRANSPORTATION STATE OF GEORGIA	
ADD DIM'S PAV/DOWEL/TBL		STANDARD	
ADD DIM'S PAV/SAWCUT/TBL		JOINT DETAILS FOR	
REV TYP(S) & ADD LABELS		PORTLAND CEMENT CONCRETE PAVING	
REV DTL 'F' TIE BAR LOC		NO SCALE	
REV. DOWELS DIA. AND		REV. & REDRAWN MAY, 1996	
TRANSVERSE JTS. SPACING		DES. _____ (SUBMITTED) <i>B. A. H.</i>	
AND REV. GEN. NOTE 8.		DRW. _____	
REV. GEN. NOTE 3, 7 & 8.		TRA. _____	
1/4" TRANSVERSE JOINT		CHK. _____	
DATE		STATE ROAD & AIRPORT DESIGN ENGINEER	
REVISION		CHIEF ENGINEER	
BY		NUMBER	
RHC		5046H	